


LOC I-BZN 109.3	APP CRS 123°	Rwy Ldg 8994 TDZE 4443 Apt Elev 4473
---------------------------	------------------------	---


ILS Y RWY 12 (SA CAT II)
BOZEMAN YELLOWSTONE INTL (BZN)

 -21°C	DME from BZN VOR/DME. DME use requires simultaneous reception of I-BZN and BZN DME. Requires specific OPSPEC, MSPEC, or LOA approval. Procedure NA when tower closed.	 MALS R	MISSED APPROACH: Climb to 5200 then climbing right turn to 9000 on heading 250° and on BZN VOR/DME R-223 to BRGR INT/BZN VOR/DME 15 DME and hold. Continue climb-in-hold to 9000.
---	---	--	---

ATIS 135.425	BIG SKY APP CON ★ 118.975 226.675	BOZEMAN TOWER ★ 118.2 (CTAF) 0	GND CON 121.8	UNICOM 122.95
------------------------	---	--	-------------------------	-------------------------

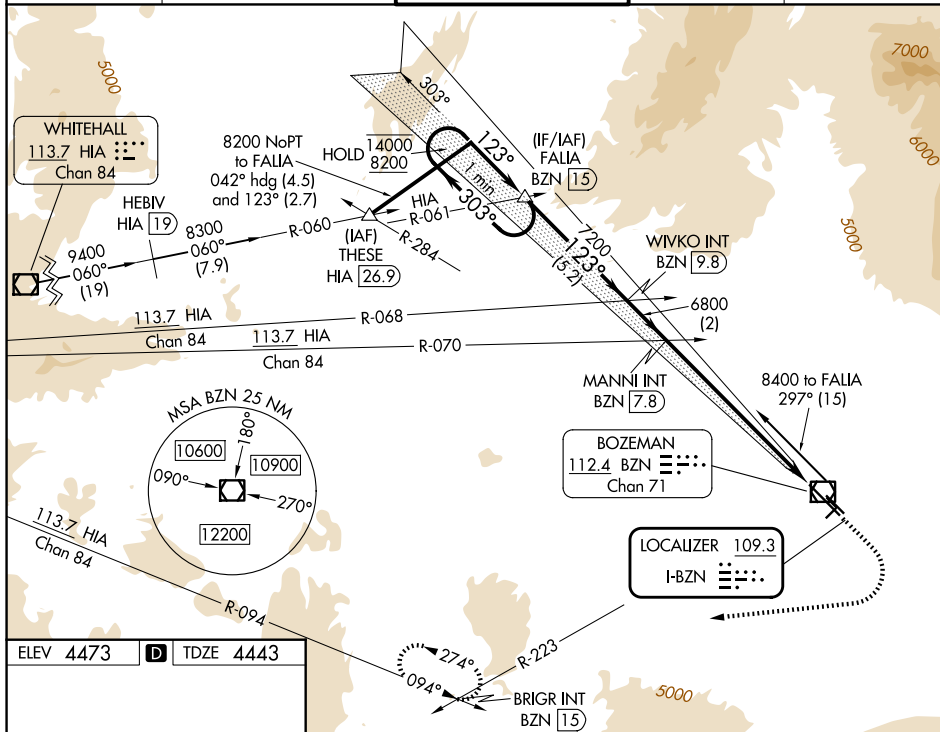

ELEV 4473	D	TDZE 4443
-----------	----------	-----------

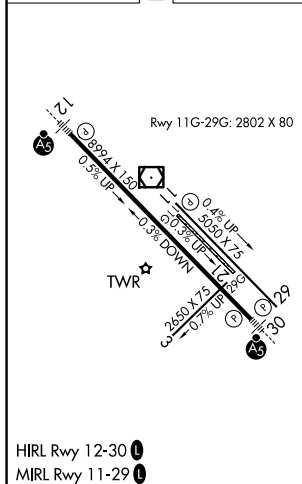

One Minute Holding Pattern

FALIA BZN (15)

WIVKO INT BZN (9.8)

MANINI INT BZN (7.8)

14000 ← 303°

8200 ← 123°

7200

6800

6800

915°

5.2 NM

2 NM

7.3 NM

GS 3.00°

TCH 53

CATEGORY	A	B	C	D
S-ILS 12	RA 120/12 100 DA 4543			

SA CATEGORY II ILS - SPECIAL AIRCREW & AIRCRAFT CERTIFICATION REQUIRED

ILS Y RWY 12 (SA CAT II)