

APP CRS	Rwy Idg	7701
317°	TDZE	24
	Apt Elev	29


RNAV (RNP) Y RWY 32

JACKSONVILLE INTL (JAX)

For uncompensated Baro-VNAV systems, procedure NA below -5°C (23°F) or above 54°C (130°F). GPS required.

MISSED APPROACH: Climb to 2000 on track 317° to OSBAJ and hold.

D-ATIS	JACKSONVILLE APP CON	JACKSONVILLE TOWER	GND CON	CLNC DEL	CPDLC
125.85	119.0 269.9	118.3 317.7	121.9 348.6	119.5 290.275	

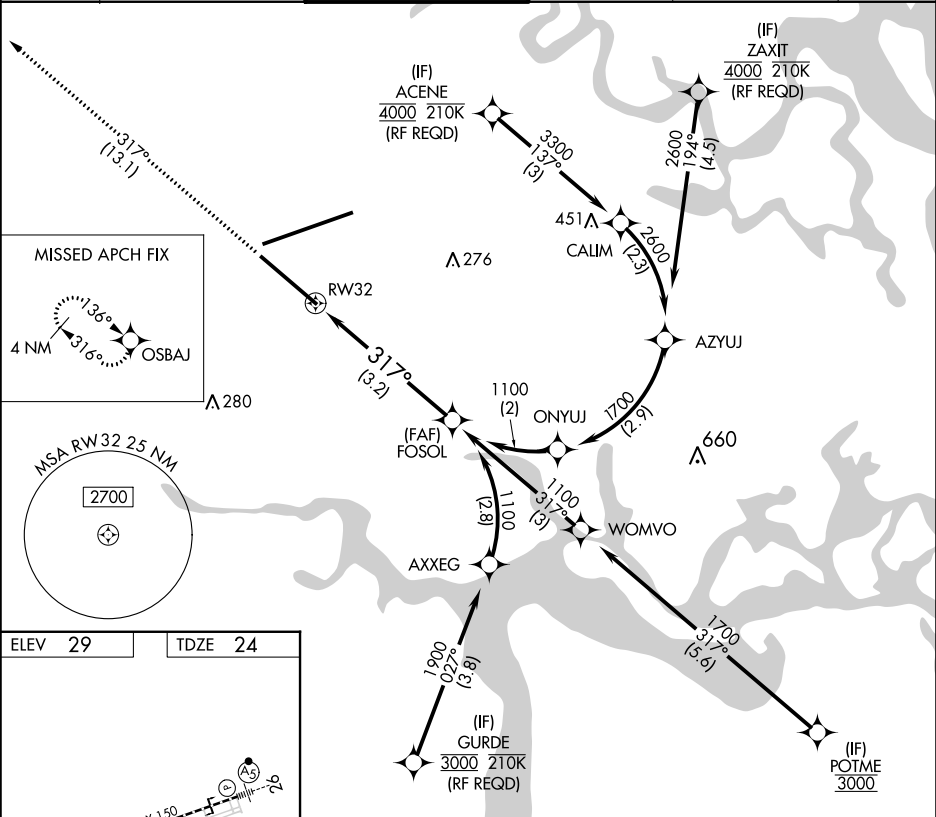

ELEV 29

TDZE 24

2000

OSBAJ

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 67).

FOSOL

1100

GP 3.00° TCH 50

RW32

317°

See planview for multiple IF locations.

3.2 NM

CATEGORY	A	B	C	D
RNP 0.11 DA		359-1 1/8	334 (400-1 1/8)	
RNP 0.30 DA		423-1 3/8	399 (400-1 3/8)	

AUTHORIZATION REQUIRED